

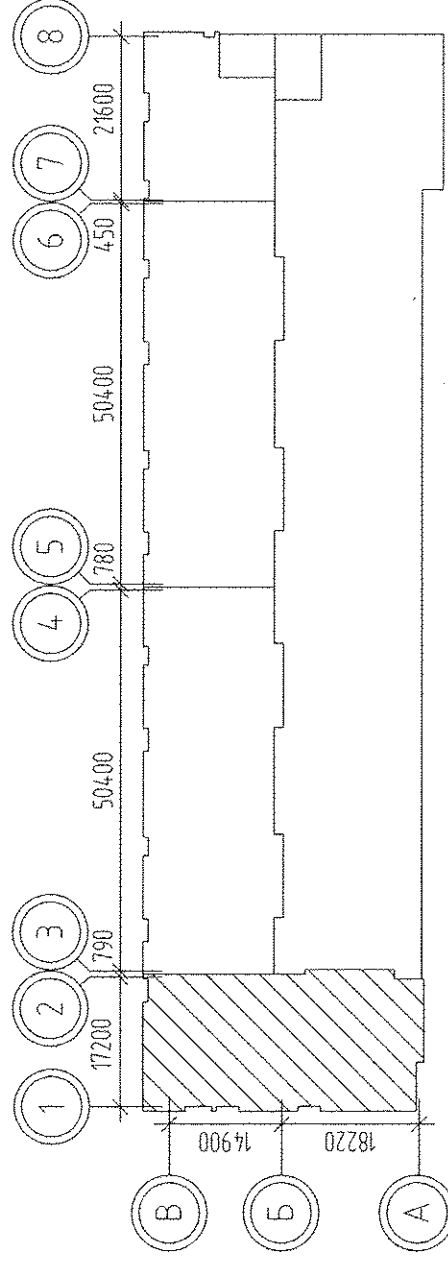


Имя, № подл.	Подпись и дата	Взам. инв. №
--------------	----------------	--------------

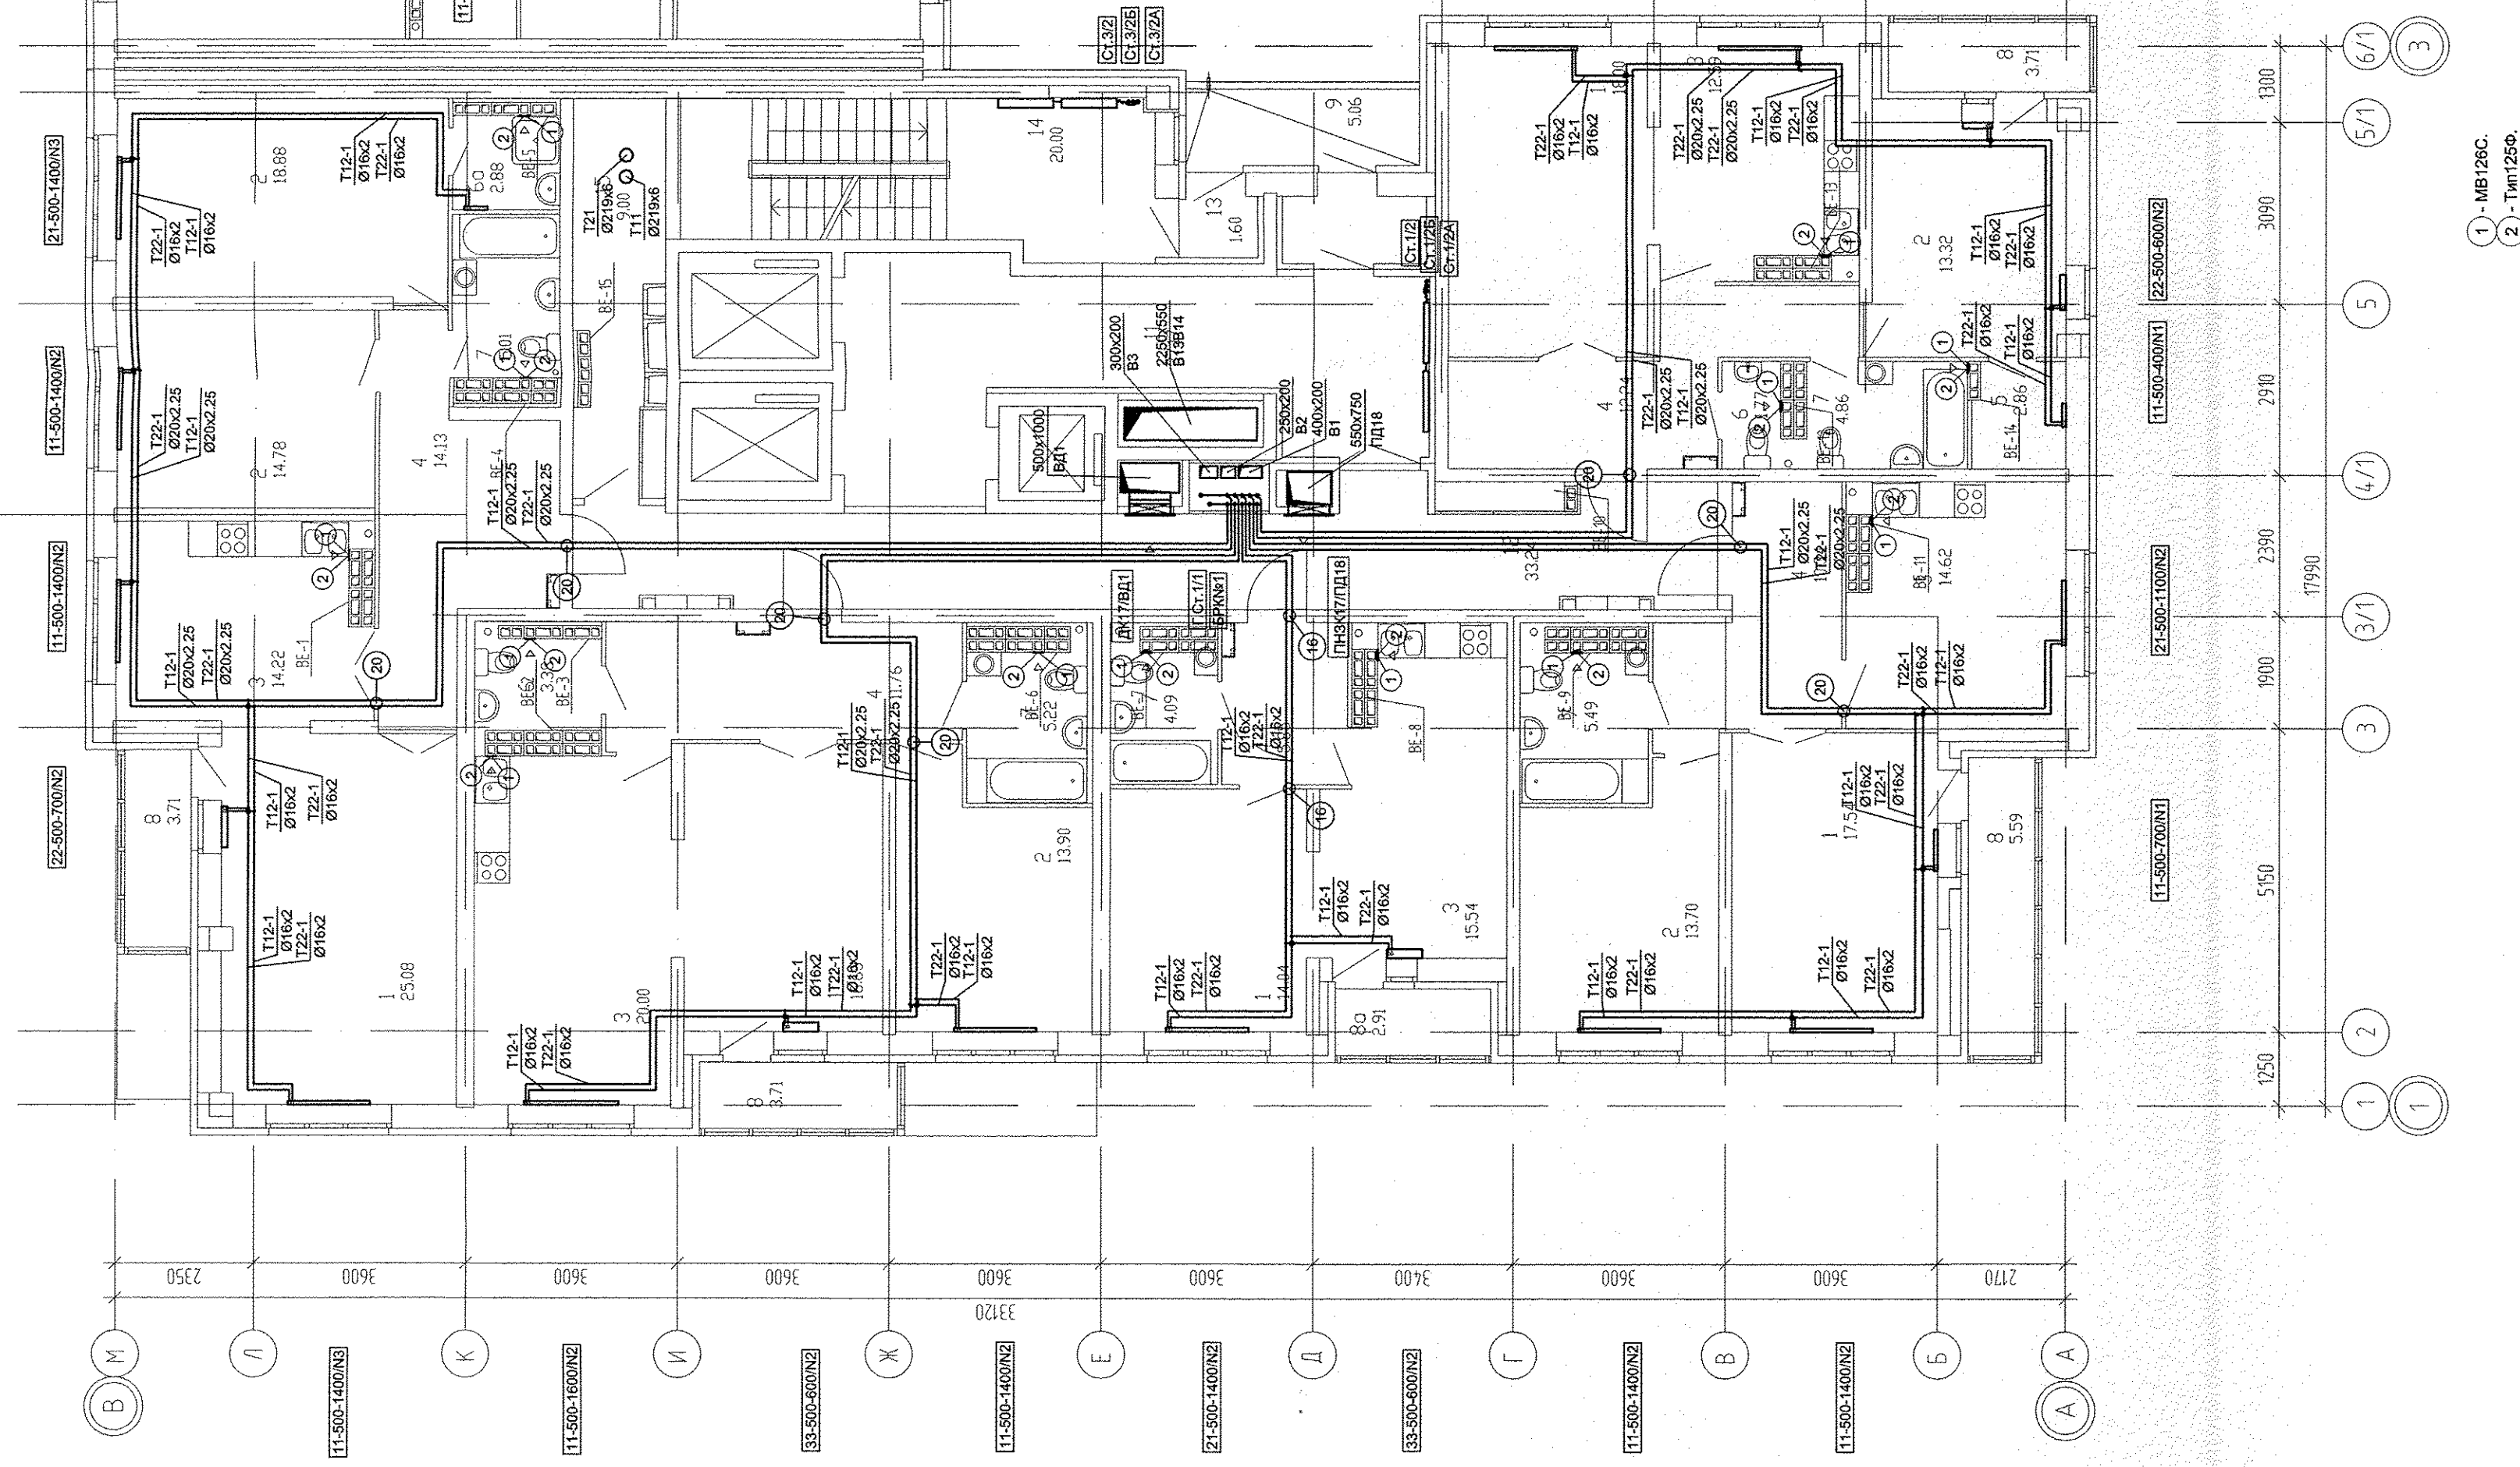

G ₁ 375	18	KC20-1-593K	KC20-1-593K
	17	KC20-1-593K	KC20-1-593K
	16	KC20-1-593K	KC20-1-593K
	15	KC20-1-593K	KC20-1-593K
	14	KC20-1-593K	KC20-1-593K
	13	KC20-1-593K	KC20-1-593K
G ₁ 125	17	KC20-1-015K	KC20-1-015K
	16	KC20-1-020K	KC20-1-020K
	15	KC20-1-483K	
	16	KC20-1-353K	
	14	KC20-1-240K	
	13	KC20-1-127K	

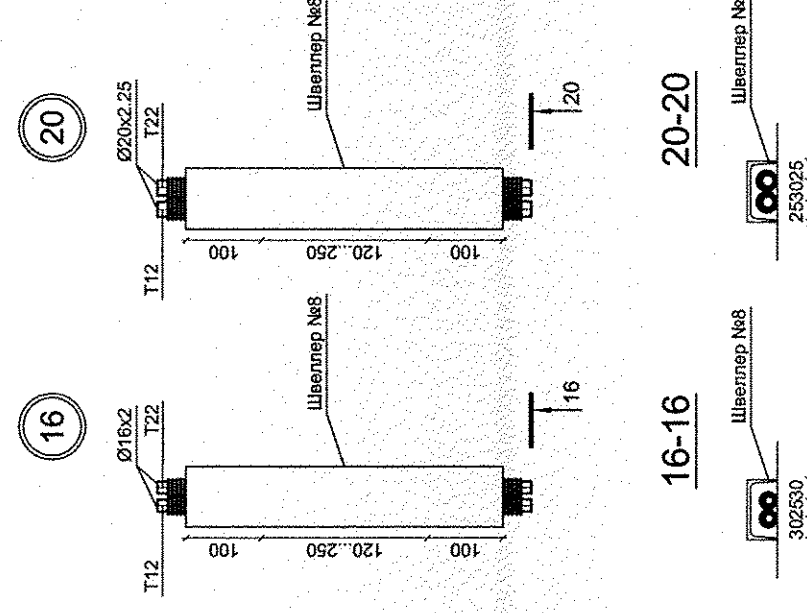

1 - MB126C.
2 - Тип125Ф.

1. N - Настройка встроеной вентиляционной вставки
2. От стен, ось трубы на 250мм.

[illegible]